



REVISIONS			
REV	DESCRIPTION	DATE	APPROVED

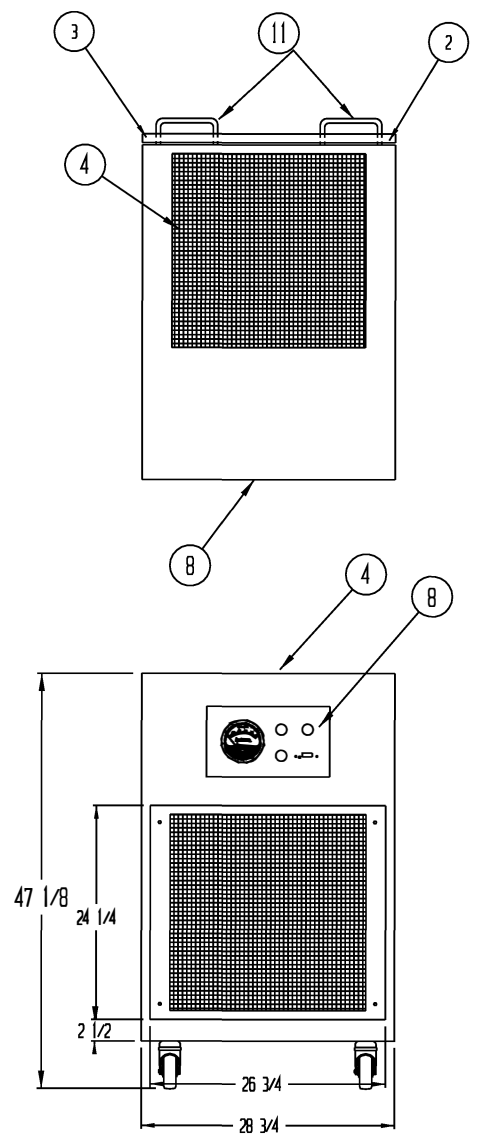

NOTES:

- HOUSING CONSTRUCTED OF 16 GA. 304 STAINLESS STEEL WITH A #4 FINISH
- UNIT ELECTRICAL TO MEET UL507 STANDARDS
- UNIT CAPABLE OF DEVELOPING 2000 CFM AT 1.8" WC

- ① 1 EA. 10-10A DIRECT DRIVE BLOWER WITH 3/4 HP ECM MOTOR 115 VOLT, 1 PHASE 9.5 FLA CAPABLE OF 2000 CFM @ 1.8" WC
- ② BLOWER SERVICE ACCESS DOOR
- ③ PRE-FILTER SERVICE ACCESS DOOR
- ④ PERFORATED AIR INLET GRILL
- ⑤ 1" THICK GROSS PARTICULATE AIR FILTER
- ⑥ 2" THICK PLEATED PRE FILTER. MERV 8
- ⑦ 24" X 24" X 11-1/2" V-CELL HIGH CAPACITY HEPA FILTER 99.99% EFFECTIVE ON PARTICLES OF 0.3 MICRONS IN SIZE
- ⑧ CONTROL PANEL WITH MAGNETIC GAUGE FOR OPERATION VERIFICATION AND HEPA FILTER LOADING, BLOWER CONTROL SWITCH DIGITAL ECM SPEED CONTROL, PRE-FILTER AND HEPA FILTER CHANGE INDICATOR LIGHTS
- ⑨ 8 FT 115 VOLT, 15 AMP HOSPITAL GRADE POWER CORD
- ⑩ 4" DIA SWIVEL CASTERS WITH TOTAL LOCK BRAKES
- ⑪ 2EA 1/2" DIA PUSH HANDLES

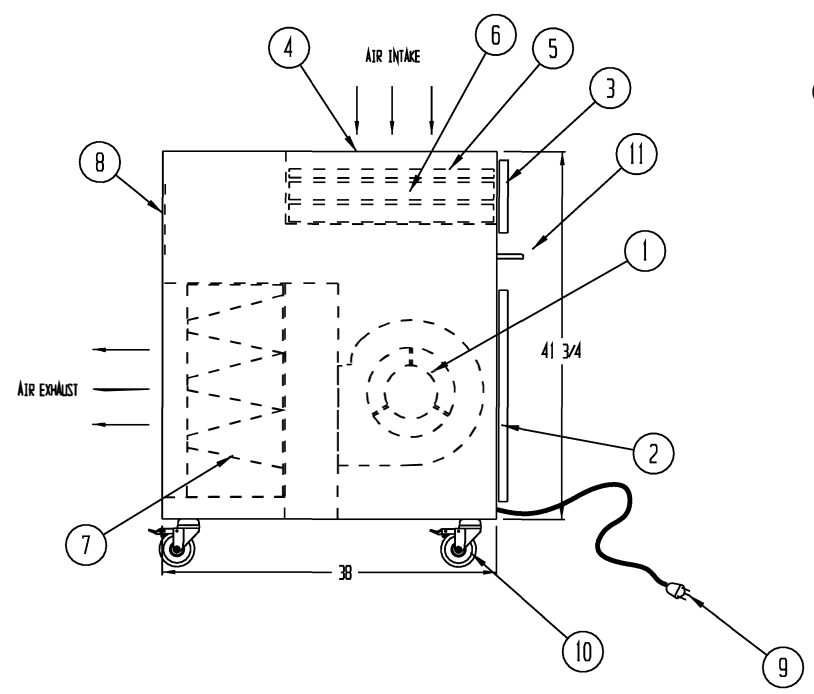

DRAWN FOR		<b>HALCO PRODUCTS COMPANY, INC.</b> 100 NO. GORDON STREET ELK GROVE, IL. 60007		
TITLE		MODEL: SA2000-SS		
DRAWN BY	DK	SIZE	JOB NO.	ENG NO.
APPROVED BY		SCALE	DATE	SHEET
		3/4" = 1"	8/28/20	19222928A